indofarma	**Catatan Pemantauan Mikrobiologi *Growth Promotion Test Room* (GPT), *Total Microbial Test Room 1*, *Total Microbial Test Room 2*, *Media Plating Room*, *Sample Potency Preparation Room*, dan *Potency Test Room***	No : FPM036 Revisi : 02 Berlaku : 12 Agu 2019 Hal. : 1/3

No. :

Bulan : **Minggu :**

Petugas sampling : **Tanggal sampling :**

Keterangan :

Hasil Pemeriksaan

Ruang : Growth Promotion Test Room
Kondisi Ruangan : Suhu : RH :

No	Lokasi Sampling	Kelas	Satuan	Metoda	Action Limit	Alert Limit	Hasil Analisis	
							Perhitungan	Rata-rata
1	Udara BSC	A	Kol/plate	SP	<1	<1		
2	Udara	D	Kol/plate	SA	200	120		
3	Lantai	D	Kol/plate	CP	50	30		

Ruang : Total Microbial Test Room 1
Kondisi Ruangan : Suhu : RH :

No	Lokasi Sampling	Kelas	Satuan	Metoda	Action Limit	Alert Limit	Hasil Analisis	
							Perhitungan	Rata-rata
1	Udara BSC	A	Kol/plate	SP	<1	<1		
2	Udara	D	Kol/plate	SA	200	120		
3	Lantai	D	Kol/plate	CP	50	30		

Ruang : Total Microbial Test Room 2
Kondisi Ruangan : Suhu : RH :

No	Lokasi Sampling	Kelas	Satuan	Metoda	Action Limit	Alert Limit	Hasil Analisis	
							Perhitungan	Rata-rata
1	Udara BSC	A	Kol/plate	SP	<1	<1		
2	Udara	D	Kol/plate	SA	200	120		
3	Lantai	D	Kol/plate	CP	50	30		

Ruang : Media Plating Room
Kondisi Ruangan : Suhu : RH :

No	Lokasi Sampling	Kelas	Satuan	Metoda	Action Limit	Alert Limit	Hasil Analisis	
							Perhitungan	Rata-rata
1	Udara LAF	A	Kol/plate	SP	<1	<1		
2	Udara	D	Kol/plate	SA	200	120		
3	Lantai	D	Kol/plate	CP	50	30		

Ruang : Sample Potency Preparation Room
Kondisi Ruangan : Suhu : RH :

No	Lokasi Sampling	Kelas	Satuan	Metoda	Action Limit	Alert Limit	Hasil Analisis	
							Perhitungan	Rata-rata
1	Udara	D	Kol/plate	SP	100	60		
2	Udara	D	Kol/plate	SA	200	120		
3	Lantai	D	Kol/plate	CP	50	30		

indofarma	**Catatan Pemantauan Mikrobiologi *Growth Promotion Test Room* (GPT), *Total Microbial Test Room 1*, *Total Microbial Test Room 2*, *Media Plating Room*, *Sample Potency Preparation Room*, dan *Potency Test Room***	No : FPM036 Revisi : 02 Berlaku : 12 Agu 2019 Hal. : 2/3

No. :

Bulan : **Minggu :**

Petugas sampling : **Tanggal sampling :**

Keterangan :

Hasil Pemeriksaan

Ruang : Potency Test Room
Kondisi Ruangan : Suhu : RH :

No	Lokasi Sampling	Kelas	Satuan	Metoda	Action Limit	Alert Limit	Hasil Analisis		
							Perhitungan		Rata-rata
1	Udara LAF	A	Kol/plate	SP	<1	<1			
2	Udara	D	Kol/plate	SA	200	120			
3	Lantai	D	Kol/plate	CP	50	30			

Contact Plate (CP), *Settling Plate* (SP), *Slit to Agar* (SA)
Kontrol Blanko Cawan Petri :
Kontrol Blanko *Contact Plate* :

Tgl. Selesai Uji : Analis :

Catatan :

Kesimpulan :

Bekasi,

Asman Pengujian Mikrobiologi dan IPC

indofarma	**Catatan Pemantauan Mikrobiologi *Growth Promotion Test Room* (GPT), *Total Microbial Test Room 1*, *Total Microbial Test Room 2*, *Media Plating Room*, *Sample Potency Preparation Room*, dan *Potency Test Room***	No	: FPM036
		Revisi	: 01
		Berlaku	: 12 Agu 2019
		Hal.	: 3/3
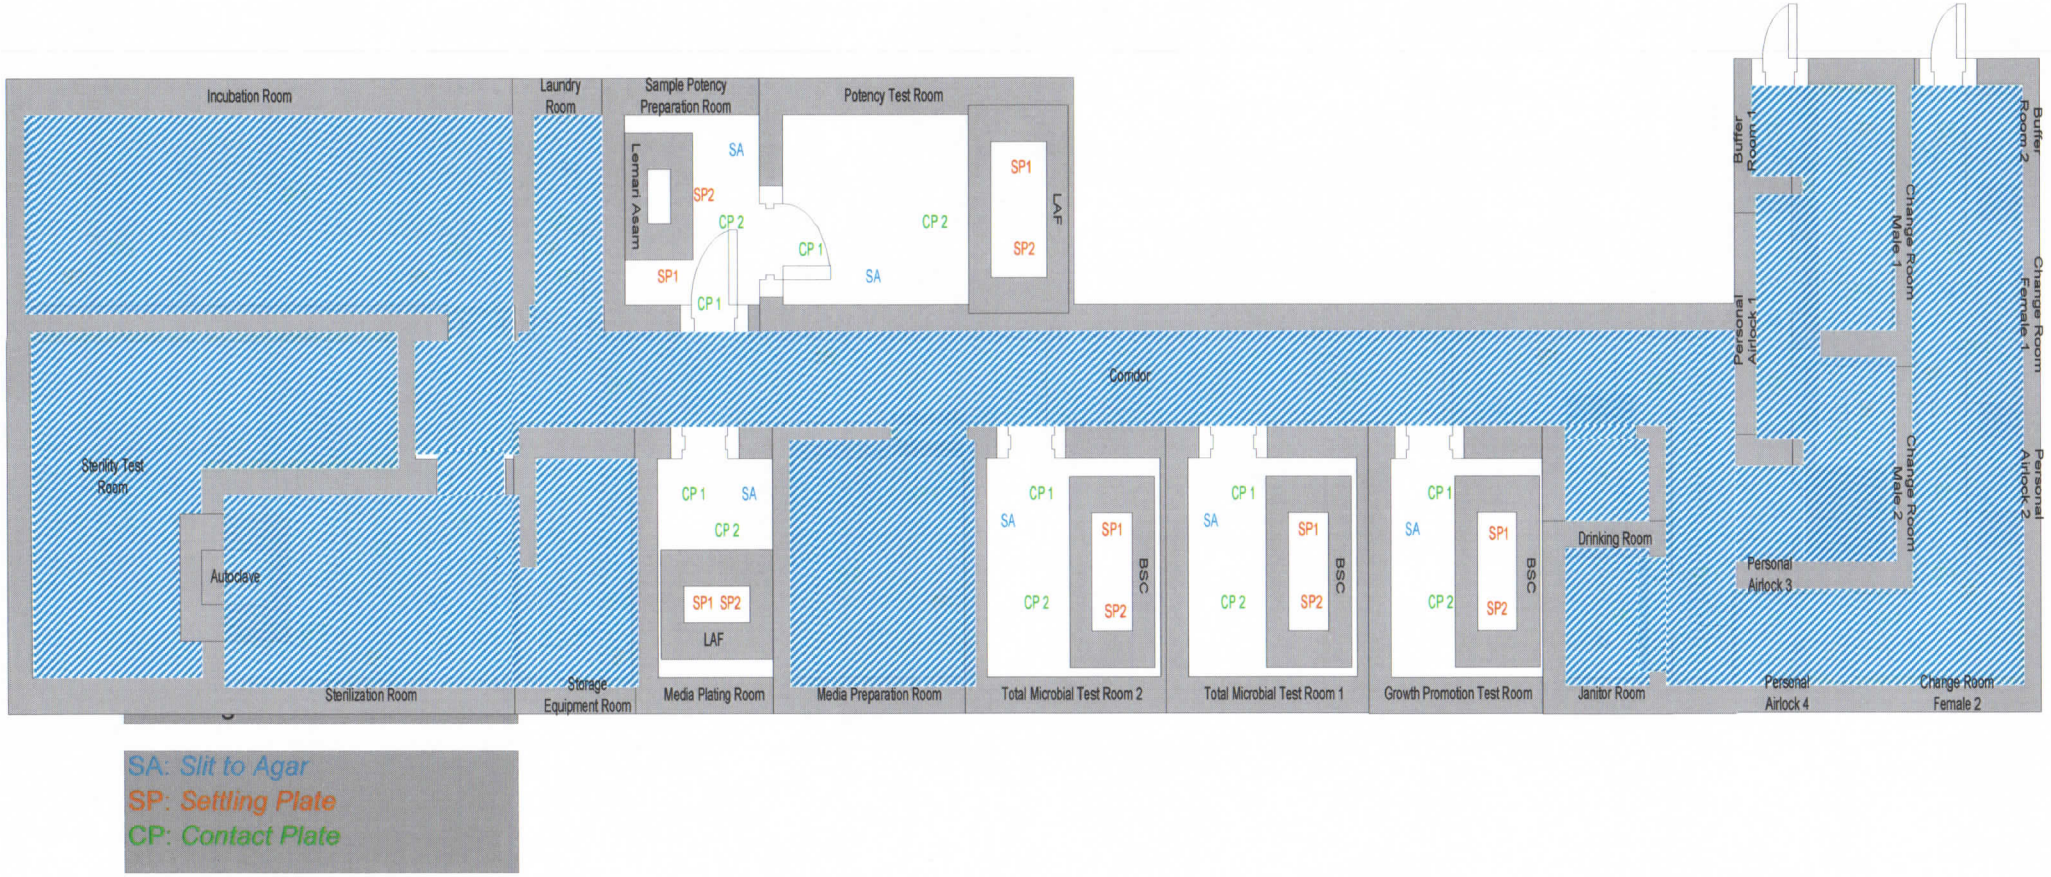
Denah Lokasi Sampling *Growth Promotion Test Room* (GPT), *Total Microbial Test Room 1*, *Total Microbial Test Room 2*, *Media Plating Room*, *Sample Potency Preparation Room*, dan *Potency Test Room*